# Feasibility Study and Developing Appropriate Hybrid Energy Systems in Regional Level

Ahmad Rouhani

Abstract—Iran has several potential for using renewable energies, so use them could significantly contribute to energy supply. The purpose of this paper is to identify the potential of the country and select the appropriate DG technologies with consideration the potential and primary energy resources in the regions. In this context, hybrid energy systems proportionate with the potential of different regions will be determined based on technical, economic, and environmental aspect. In the following the proposed structure will be optimized in terms of size and cost. DG technologies used in this project include photovoltaic system, wind turbine, diesel generator and battery bank. The HOMER software is applied for choosing the appropriate structure and the optimization of system sizing. The results have been analyzed in terms of technical and economic. The performance and the cost of each project demonstrate the appropriate structure of hybrid energy system in that region.

**Keywords**—Feasibility, Hybrid Energy System, Iran, Renewable Energy.

# I. INTRODUCTION

ENERGY is the most important and most essential principle known in economic development. Nowadays, the bulk of energy demand used for economic and social growth is supplied by fossil fuels [1]. On the other hand, the significant increase in energy consumption, non-renewable nature of fossil fuel, high fossil fuel costs, and environmental concerns are major factors in the development of renewable energies. Energy consumption is rapidly increasing in developing countries, which have a significant impact on climate change and global and regional energy management. Mentioned issues lead to many countries planning to reduce dependence on fossil fuels as the primary energy source. Appropriate generation expansion with regard to long-term generation expansion planning can be done with renewable energy sources.

Among the different energy sources, electricity has a key role in achieving political and economic development. Electrical energy consumption is rapidly increasing in Iran as a developing country. Then, the government has the responsibility to plan and build a new plant to increase production capacity in the country. Also it should be noted that the state sector cannot develop the generation for all regions. So, encourage the private sector is necessary to participate in the generation development process. In this regard, from the perspective of the private sector invest in the Distributed Generation (DG) is very important due to lower

Ahmad Rouhani is with the Young Researchers and Elite Club, Beyza Branch, Islamic Azad University, Beyza, Iran (phone: +98 71 36783257; fax: +98 71 36783256; e-mail: rouhani@biau.ac.ir).

initial construction investment and lower financial risk [2]. In recent years, the Iranian department of energy has encouraged the private investors and companies to invest in distributed generation units to supply the energy demands. This strategy is for restructuring in power system and moving towards privatization.

Multiple energy sources including Wind Generator (WG), Photovoltaic panels (PV), Fuel Cells (FC), diesel generators, gas turbines and micro turbines can be combined together to form an hybrid energy system [3]-[10]. Among them, solar and wind are the most important sources of renewable energy. Therefore, the development of energy systems with WG and PV has a significant progress. The solar-wind hybrid system is a new energy source which due to environmental aspect and being renewable, many countries are interested in applying this structure and performing extensive research [11]. But because of the intermittent nature of wind and solar, using the energy storage for use in times of need is necessary. Often the batteries are used for energy storage [5], [11]. Also, the combination of FC and electrolyzer also are used for energy storage [7]-[10], [12]. So with the proper combination of DG technologies and suitable energy management, a high reliability hybrid energy system could be used to meet the load [3]-[10].

National Renewable Energy Laboratory's (NREL) Hybrid Optimization Model for Electric Renewable (HOMER) software has been employed to carry out the present study. HOMER performs comparative economic analysis on a distributed generation power systems.

Inputs to HOMER will perform an hourly simulation of every possible combination of components entered and rank the systems according to user-specified criteria, such as cost of energy (COE, US\$/kWh) or capital costs. Furthermore, HOMER can perform 'sensitivity analyses' in which the values of certain parameters (e.g., solar radiation or wind speed) are varied to determine their impact on the system configuration [13].

Iran has 17 Regional Electricity Companies (REC), 28 Electrical Power Management Companies and 42 Electrical Power Distribution Companies. The purpose of this paper is identifying the potential of the primary energy resources available in each REC and selecting the DG technology proportional to each region. In this regard, the hybrid energy systems appropriate for different regions based on economic characteristics, performance and environmental features will be analyzed and optimum structures will be suggested.

This paper is organized as follows: In Section II, the renewable energy sources in Iran is reviewed. Section III

shows how the optimization problem is simulated, with details of the load profile and weather data. Technical and economic analysis of hybrid energy systems are presented in Section IV. Finally, the conclusion of the paper is described in Section V.

#### II. RENEWABLE ENERGY SOURCES IN IRAN

In recent years, Iran has increased the use of renewable energy. The investments on solar and wind energy lead to increase generation capacity of wind and solar power plants. For example, 'Yazd' (REC 12) is center of development power generation from solar and 'Khorasan' (REC 15) is center of development power generation from wind in Iran. In addition to these two regions, many other areas around the country have been identified that number of days with direct sunlight or number of days with high wind speed are high [14].

In the past few years with the help of international institutions such as the German Research Institute wind and solar maps have developed for investment in renewable energy. Some of the available potential in the country has described in the following.

# A. Wind Energy Potential in Iran

Studies and estimating calculations in the wind energy potential in Iran have shown proper potential of wind energy. Fig. 1 shows the potential sources of wind power in Iran in 20 *m* altitude. As shown in Fig. 1, wind power projects in three provinces of Gilan (REC 3), South Khorasan (REC 15), and Sistan and Baluchestan (REC 16) are economically affordable.

In 2004, from 33,000 MW power production in Iran, only 25 MW were produced by wind power. In 2006, the contribution of power generated by wind power was 45 MW. In 2008, wind power capacity in Manjil (in Gilan province-REC 3) and Binalud (in Khorasan Razavi Province-REC 15), was 82 MW. The wind power capacity in 2009 was 130 MW.

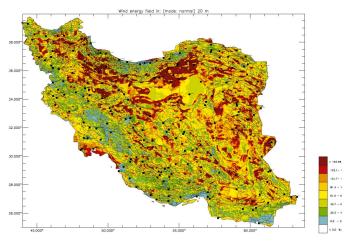


Fig. 1 Potential sources of wind power in Iran in 20 m altitude [14]

# B. Solar Energy Potential in Iran

Iran is located in areas of high solar radiation. Studies show that the use of solar energy in Iran is appropriate and can provide part of the energy demands of the country. Iran is a country with 300 sunny days in more than two/thirds of country. The average solar radiation between 4.5-5.5 kWh/m² in a day demonstrates that Iran is one of the countries with high solar energy potential. Fig. 2 shows the potential sources of solar irradiation in Iran.

#### C. Variety of energy in Iran

Iran has a perfect position in terms of various energy resources and has the opportunities for develop them. According to the map shown in Fig. 3, it could be find that different regions have various potential of energy resources. This issue could provide an opportunity to supply the demand with diverse energy sources in the country. Another important point is that these resources are distributed across the country:

- Geothermal resources in the West and Northwest
- High wind speed in the North and East
- Proper solar radiation in Central, South and Southeast
- Oil and gas resources in the West and South
- Coal resources in the East

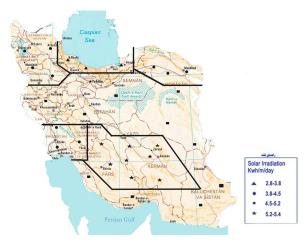


Fig. 2 Potential sources of solar irradiation in Iran [14]




Fig. 3 Potential of energy resources in different regions in Iran

# III. METHODOLOGY AND SYSTEM CHARACTERISTICS

In order to analyze and compare the appropriate hybrid energy systems based on the available potential of energy resources in the country, four different regions have been considered. The HOMER software is applied to modeling and performing technical and economic studies of the hybrid energy systems proposed in each region.

# A. HOMER Software Simulation Models

In the present work, the selection and sizing of components of hybrid power system has been done using NREL's HOMER software. HOMER is a general purpose hybrid system design software that facilitates design of electric power systems for stand-alone applications [13]. Input information of HOMER includes: electrical loads (one year of load data), renewable resources, component technical details and costs, constraints, controls, type of dispatch strategy, etc. HOMER designs an optimal power system to serve the desired loads.

HOMER is a simplified optimization model, which performs hundreds or thousands of hourly simulations over and over (to ensure best possible matching between supply and demand) in order to design the optimum system. It uses life cycle cost to rank order these systems [13].

In order to verify the system performance under different situation in HOMER software, simulation studies have been carried out using real weather data (solar irradiance and wind speed). The goal of the optimization process is to determine the optimal value of each decision variable that interests the modeler. A decision variable is a variable over which the system designer has control and for which HOMER can consider multiple possible values in its optimization process. In this study, decision variables in HOMER include:

- The size of the PV array
- The number of WG
- The number of Diesel generator
- The capacity of batteries
- The size of the DC/AC converter

#### B. Renewable Source Availability

In the previous sections, the potential of renewable energy in Iran were described. Table I shows the proposed energy sources to supply depended or independent application in each region. In accordance with Fig. 4, in this paper Iran is divided into four hypothetical "North", "South", "East" and "West" with regard to available energy resources.

# C. Load Profile

In this research, the load profile of an imaginary village is considered for all regions. According to load forecast, the annual energy consumption for the proposed area is 623 kWh/d. Fig. 5 shows the load profiles in a sample day and Fig. 6 shows the monthly load variation profile. The peak requirements of the load dictate the system size. In this study 65.1 (kW) has been considered to scale peak load.

TABLE I
AVAILABLE ENERGY RESOURCES ASSUMED FOR EACH REGION

Region	Renewable resources	Non-renewable resources
North	Wind	Electricity grid
South	Solar	Diesel
East	Wind & Solar	
West		Diesel

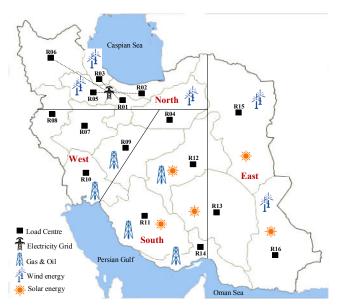


Fig. 4 Regional boundaries assumed for energy resources for Iran

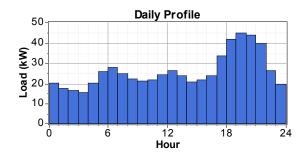


Fig. 5 Load profiles in a sample day

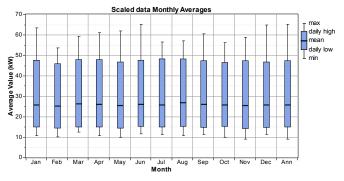


Fig. 6 Monthly load variation profile

#### D. Weather Data

A monthly average of 20 years of wind speed and solar radiation data for the geographic centre of each region is given according to Table II [15]. The information of solar radiation and wind speed can be used for analysis of hybrid energy system consisting of photovoltaic panels and wind turbines.

Figs. 7 and 8 show the monthly average daily wind speed for North and East. Figs. 9 and 10 illustrate the monthly average daily solar radiation for South and East.

TABLE II

MONTHLY AVERAGE WIND SPEED AND SOLAR IRRADIATION
FOR PROPOSED REGIONS

Region	North	South	East				
Weather Data	Wind speed (m/s)	Solar irradiation (kWh/m²/d)	Wind speed (m/s)	Solar irradiation (kWh/m²/d)			
January	5.63	3.34	5.42	3.47			
February	6.04	4.45	5.80	4.34			
March	6.95	5.24	5.99	5.01			
April	7.47	6.02	5.61	5.96			
May	7.11	6.97	6.44	7.04			
Jun	8.08	7.45	7.32	7.06			
July	9.61	7.02	8.28	7.40			
August	9.48	6.62	8.07	7.14			
September	7.34	5.99	7.01	6.28			
October	6.03	4.93	5.70	4.93			
November	5.05	3.83	5.03	3.76			
December	5.31	3.24	5.43	3.15			

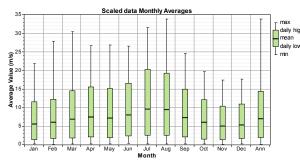


Fig. 7 Monthly average daily wind speed for North




Fig. 8 Monthly average daily wind speed for East

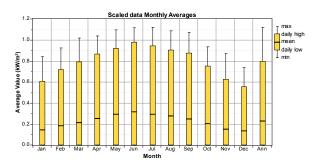


Fig. 9 Monthly average daily solar radiation for South

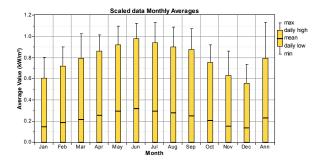


Fig. 10 Monthly average daily solar radiation for East

# IV. TECHNICAL AND ECONOMIC ANALYSIS OF HYBRID ENERGY SYSTEMS

On the design point of view, the optimization of the size of hybrid plants is very important, and leads to a good ratio between cost and performances [16]-[19]. Figs. 11-14 show the structure of the hybrid energy systems studied in different regions. The hybrid energy system used in the North is WG/battery and is applied in stand-alone applications. Similarly, the hybrid energy system in the South is PV/diesel generator/ battery. The hybrid energy system used in the East is WG/PV/battery and the hybrid energy system used in the West is diesel generator/battery. Technical data of the components used in the system are shown in Table III.

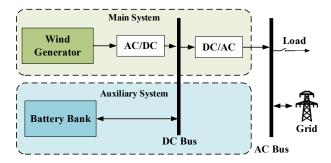


Fig. 11 Proposed hybrid energy system configuration in North

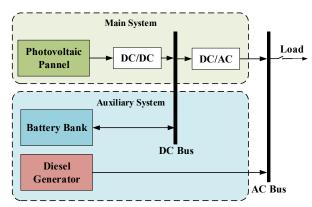


Fig. 12 Proposed hybrid energy system configuration in South




Fig. 13 Proposed hybrid energy system configuration in East




Fig. 14 Proposed hybrid energy system configuration in West

#### A. Technical Analysis

According to the explanations given in the previous sections, the proposed hybrid energy systems are modelled and analysed by HOMER software. A schematic of the hybrid energy systems in different regions are shown in Figs. 15-18.




Fig. 15 Proposed system configuration in HOMER in North




Fig. 16 Proposed system configuration in HOMER in South




Fig. 17 Proposed system configuration in HOMER in East




Fig. 18 Proposed system configuration in HOMER in West

 $\label{thm:table III} Technical \ Data \ of the \ Components \ Used \ in \ the \ System$ 

Technology Capital Cost O & M Cost O & M Cost Efficiency Lifetime Tracking system Wind Generator Technology Power Capital Cost O & M Cost Technology Power Toak M Cost O & M Cost O Tracking Wind Generator Technology Power Toak M Cost O & M Cos	Photovoltaic Panel	3 CSLD IIV THE STOTEW	
Capital Cost         4850 USS/kWpk           O & M Cost         0           Efficiency         15 %           Lifetime         25 year           Tracking system         No Tracking           Wind Generator         Technology           Technology         Fahrlander 100           Power         100 kW           Capital Cost         320000 US\$           O & M Cost         300 US\$/year           Lifetime         25 year           Diesel Generator         VOLVO-GSW           Rated Power         50 kW           Voltage and Frequency         400 v , 50 Hz           Capital cost         10000 US\$           Lifetime         25 year           Battery         Technology           Technology         Lead-acid           Capital cost         8000 US\$           Replacement cost         6000 US\$           Charging Efficiency         80 %           Lifetime         5000 hour           Converter         25 kW           Capital cost         15000 US\$           Replacement cost         15000 US\$           Efficiency         95 %           Lifetime         20 year           Project D	Technology	Poly Crystalline	
Efficiency Lifetime Tracking system Wind Generator Technology Power Capital Cost O & M Cost Lifetime Diesel Generator Technology Rated Power Voltage and Frequency Capital cost Lifetime Diesel Generator Technology Rated Power Technology Rated Power Technology Rated Power Technology Rated Power So kW Voltage and Frequency Capital cost Lifetime Diesel Generator Technology Rated Power So kW Voltage and Frequency Lifetime So kW Voltage and Frequency Lifetime So kW Voltage and Frequency Technology Lead-acid Capital cost Replacement cost Charging Efficiency Lifetime Soud hour Converter Capacity Capital cost Replacement cost Lifetime Soud hour Converter Capacity Soud hour Converter Capacity Lifetime Soud Holod Lifetime Soud Holod Capital cost Lifetime Soud Holod Lifetime Load following Spinning reserve Load following	Capital Cost		
Lifetime         25 year           Tracking system         No Tracking           Wind Generator         Fahrlander 100           Power         100 kW           Capital Cost         320000 US\$           O & M Cost         300 US\$/year           Lifetime         25 year           Diesel Generator         Technology           Technology         VOLVO-GSW           Rated Power         50 kW           Voltage and Frequency         400 v , 50 Hz           Capital cost         10000 US\$           Lifetime         25 year           Battery         Technology           Technology         Lead-acid           Capital cost         8000 US\$           Replacement cost         6000 US\$           Charging Efficiency         80 %           Lifetime         5000 hour           Converter         Capacity         25 kW           Capital cost         15000 US\$           Replacement cost         15000 US\$           Efficiency         95 %           Lifetime         20 year           Project Data         25 year           Operating strategy         Load following           Spinning reserve         10	O & M Cost	0	
Tracking system Wind Generator Technology Power 100 kW Capital Cost 320000 US\$ O & M Cost Lifetime 25 year  Diesel Generator Technology Rated Power 50 kW Voltage and Frequency Capital cost Lifetime 25 year  Battery Technology Lead-acid Capital cost Battery Technology Lead-acid Capital cost Capital cost Capital cost Seplacement cost Charging Efficiency Lifetime Converter Capacity Capital cost Lifetime Diesel Generator Technology Lead-acid Capital cost Seplacement cost Couptal cost Seplacement cost Charging Efficiency Lifetime Diesel Generator Technology Lead-acid Capital cost Seplacement cost Seplacement cost Seplacement cost Seplacement cost Lifetime Diesel Generator Technology Lead-acid Seplacement cost Seplac	Efficiency	15 %	
Wind Generator           Technology         Fahrlander 100           Power         100 kW           Capital Cost         320000 US\$           O & M Cost         300 US\$/year           Lifetime         25 year           Diesel Generator         VOLVO-GSW           Technology         VOLVO-GSW           Rated Power         50 kW           Voltage and Frequency         400 v , 50 Hz           Capital cost         10000 US\$           Lifetime         25 year           Battery         Lead-acid           Technology         Lead-acid           Capital cost         8000 US\$           Replacement cost         6000 US\$           Charging Efficiency         80 %           Lifetime         5000 hour           Converter         Capacity         25 kW           Capital cost         15000 US\$           Replacement cost         15000 US\$           Replacement cost         15000 US\$           Efficiency         95 %           Lifetime         20 year           Project Data         25 year           Operating strategy         Load following           Spinning reserve         10 % of the load <td>Lifetime</td> <td>25 year</td>	Lifetime	25 year	
Technology Power Capital Cost O & M Cost Diesel Generator Technology Rated Power So kW Voltage and Frequency Capital cost Uffetime So year  Battery Technology Lifetime So year  Battery Technology Technology Rated Power So kW Voltage and Frequency So kW Voltage and Frequency Lifetime So year  Battery Technology Lead-acid Capital cost Replacement cost Charging Efficiency Lifetime Sound USS Charging Efficiency Lifetime Sound bour Converter Capacity Capital cost Replacement cost Lifetime Sound USS Lifetime Sound USS Replacement Cost Lifetime Sound USS Lifetime Load following Spinning reserve Load following	Tracking system	No Tracking	
Power         100 kW           Capital Cost         320000 US\$           O & M Cost         300 US\$/year           Lifetime         25 year           Diesel Generator         VOLVO-GSW           Rated Power         50 kW           Voltage and Frequency         400 v , 50 Hz           Capital cost         10000 US\$           Lifetime         25 year           Battery         Lead-acid           Technology         Lead-acid           Capital cost         8000 US\$           Replacement cost         6000 US\$           Charging Efficiency         80 %           Lifetime         5000 hour           Converter         25 kW           Capital cost         15000 US\$           Replacement cost         15000 US\$           Replacement cost         15000 US\$           Efficiency         95 %           Lifetime         20 year           Project Data         25 year           Project Life Time         25 year           operating strategy         Load following           Spinning reserve         10 % of the load	Wind Generator		
Capital Cost         320000 US\$           O & M Cost         300 US\$/year           Lifetime         25 year           Diesel Generator         VOLVO-GSW           Rated Power         50 kW           Voltage and Frequency         400 v , 50 Hz           Capital cost         10000 US\$           Lifetime         25 year           Battery         Lead-acid           Technology         Lead-acid           Capital cost         8000 US\$           Replacement cost         6000 US\$           Charging Efficiency         80 %           Lifetime         5000 hour           Converter         25 kW           Capital cost         15000 US\$           Replacement cost         15000 US\$           Replacement cost         15000 US\$           Efficiency         95 %           Lifetime         20 year           Project Data         Project Life Time         25 year           operating strategy         Load following           Spinning reserve         10 % of the load	Technology	Fahrlander 100	
O & M Cost         300 US\$/year           Lifetime         25 year           Diesel Generator         VOLVO-GSW           Rated Power         50 kW           Voltage and Frequency         400 v , 50 Hz           Capital cost         10000 US\$           Lifetime         25 year           Battery         Lead-acid           Technology         Lead-acid           Capital cost         8000 US\$           Replacement cost         6000 US\$           Charging Efficiency         80 %           Lifetime         5000 hour           Converter         Capacity         25 kW           Capital cost         15000 US\$           Replacement cost         15000 US\$           Replacement cost         15000 US\$           Efficiency         95 %           Lifetime         20 year           Project Data         Project Life Time         25 year           Operating strategy         Load following           Spinning reserve         10 % of the load	Power	100 kW	
Lifetime         25 year           Diesel Generator         Technology           Rated Power         50 kW           Voltage and Frequency         400 v , 50 Hz           Capital cost         10000 US\$           Lifetime         25 year           Battery         Lead-acid           Technology         Lead-acid           Capital cost         8000 US\$           Replacement cost         6000 US\$           Charging Efficiency         80 %           Lifetime         5000 hour           Converter         25 kW           Capital cost         15000 US\$           Replacement cost         15000 US\$           Replacement cost         15000 US\$           Efficiency         95 %           Lifetime         20 year           Project Data           Project Life Time         25 year           operating strategy         Load following           Spinning reserve         10 % of the load	Capital Cost	320000 US\$	
Diesel Generator         VOLVO-GSW           Rated Power         50 kW           Voltage and Frequency         400 v , 50 Hz           Capital cost         10000 US\$           Lifetime         25 year           Battery         Lead-acid           Technology         Lead-acid           Capital cost         8000 US\$           Replacement cost         6000 US\$           Charging Efficiency         80 %           Lifetime         5000 hour           Converter         25 kW           Capital cost         15000 US\$           Replacement cost         15000 US\$           Replacement cost         15000 US\$           Efficiency         95 %           Lifetime         20 year           Project Data           Project Life Time         25 year           operating strategy         Load following           Spinning reserve         10 % of the load	O & M Cost	300 US\$/year	
Technology Rated Power So kW Voltage and Frequency Capital cost Lifetime Battery Technology Capital cost Replacement cost Charging Efficiency Lifetime Sound bour Converter Capacity Capital cost Replacement cost Capital cost Sound bour Converter Capacity Capital cost Replacement cost Sound bour Converter Capacity Capital cost Replacement cost Sound bour Converter Capacity Capital cost Sound bour Converter Capacity So	Lifetime	25 year	
Rated Power         50 kW           Voltage and Frequency         400 v , 50 Hz           Capital cost         10000 US\$           Lifetime         25 year           Battery         Technology           Technology         Lead-acid           Capital cost         8000 US\$           Replacement cost         6000 US\$           Charging Efficiency         80 %           Lifetime         5000 hour           Converter         25 kW           Capital cost         15000 US\$           Replacement cost         15000 US\$           Efficiency         95 %           Lifetime         20 year           Project Data         25 year           Operating strategy         Load following           Spinning reserve         10 % of the load	Diesel Generator		
Voltage and Frequency         400 v , 50 Hz           Capital cost         10000 US\$           Lifetime         25 year           Battery         Fechnology           Technology         Lead-acid           Capital cost         8000 US\$           Replacement cost         6000 US\$           Charging Efficiency         80 %           Lifetime         5000 hour           Converter         25 kW           Capacity         25 kW           Capital cost         15000 US\$           Replacement cost         15000 US\$           Efficiency         95 %           Lifetime         20 year           Project Data         25 year           Project Life Time         25 year           operating strategy         Load following           Spinning reserve         10 % of the load	Technology	VOLVO-GSW	
Capital cost         10000 US\$           Lifetime         25 year           Battery         Technology           Capital cost         8000 US\$           Replacement cost         6000 US\$           Charging Efficiency         80 %           Lifetime         5000 hour           Converter         25 kW           Capacity         25 kW           Capital cost         15000 US\$           Replacement cost         15000 US\$           Efficiency         95 %           Lifetime         20 year           Project Data           Project Life Time         25 year           operating strategy         Load following           Spinning reserve         10 % of the load	Rated Power	50 kW	
Lifetime         25 year           Battery         Technology         Lead-acid           Capital cost         8000 US\$           Replacement cost         6000 US\$           Charging Efficiency         80 %           Lifetime         5000 hour           Converter         25 kW           Capacity         25 kW           Capital cost         15000 US\$           Replacement cost         15000 US\$           Efficiency         95 %           Lifetime         20 year           Project Data           Project Life Time         25 year           operating strategy         Load following           Spinning reserve         10 % of the load	Voltage and Frequency	400 v , 50 Hz	
Battery         Lead-acid           Capital cost         8000 US\$           Replacement cost         6000 US\$           Charging Efficiency         80 %           Lifetime         5000 hour           Converter         25 kW           Capacity         25 kW           Capital cost         15000 US\$           Replacement cost         15000 US\$           Efficiency         95 %           Lifetime         20 year           Project Data         25 year           Project Life Time         25 year           operating strategy         Load following           Spinning reserve         10 % of the load	Capital cost	10000 US\$	
Technology Capital cost Replacement cost Charging Efficiency Lifetime Converter Capacity Capital cost Replacement cost  Converter  Capacity Capital cost Replacement cost 15000 US\$ Replacement cost 15000 US\$ Replacement cost 15000 US\$  Lifetime 20 year  Project Data  Project Life Time operating strategy Spinning reserve 10 % of the load	Lifetime	25 year	
Capital cost         8000 US\$           Replacement cost         6000 US\$           Charging Efficiency         80 %           Lifetime         5000 hour           Converter         25 kW           Capacity         25 kW           Capital cost         15000 US\$           Replacement cost         15000 US\$           Efficiency         95 %           Lifetime         20 year           Project Data         Project Life Time           operating strategy         Load following           Spinning reserve         10 % of the load	Battery		
Replacement cost         6000 US\$           Charging Efficiency         80 %           Lifetime         5000 hour           Converter         25 kW           Capacity         25 kW           Capital cost         15000 US\$           Replacement cost         15000 US\$           Efficiency         95 %           Lifetime         20 year           Project Data         Project Life Time         25 year           operating strategy         Load following           Spinning reserve         10 % of the load	Technology	Lead-acid	
Charging Efficiency         80 %           Lifetime         5000 hour           Converter         25 kW           Capacity         25 kW           Capital cost         15000 US\$           Replacement cost         15000 US\$           Efficiency         95 %           Lifetime         20 year           Project Data         Project Life Time         25 year           operating strategy         Load following           Spinning reserve         10 % of the load	Capital cost	8000 US\$	
Lifetime         5000 hour           Converter         25 kW           Capacity         25 kW           Capital cost         15000 US\$           Replacement cost         15000 US\$           Efficiency         95 %           Lifetime         20 year           Project Data         Project Life Time           operating strategy         Load following           Spinning reserve         10 % of the load	Replacement cost	6000 US\$	
Converter Capacity Capital cost Replacement cost Efficiency Lifetime Project Data Project Life Time operating strategy Spinning reserve  25 kW 15000 US\$ 15000 US\$ 25 % 20 year 20 year  Load following 10 % of the load	Charging Efficiency	80 %	
Capacity 25 kW Capital cost 15000 US\$ Replacement cost 15000 US\$ Efficiency 95 % Lifetime 20 year  Project Data  Project Life Time 25 year operating strategy Load following Spinning reserve 10 % of the load	Lifetime	5000 hour	
Capital cost         15000 US\$           Replacement cost         15000 US\$           Efficiency         95 %           Lifetime         20 year           Project Data         25 year           Operating strategy         Load following           Spinning reserve         10 % of the load	Converter		
Replacement cost 15000 US\$ Efficiency 95 % Lifetime 20 year  Project Data  Project Life Time 25 year operating strategy Load following Spinning reserve 10 % of the load	Capacity	25 kW	
Efficiency 95 % Lifetime 20 year  Project Data  Project Life Time 25 year operating strategy Load following Spinning reserve 10 % of the load	Capital cost	15000 US\$	
Lifetime20 yearProject Data25 yearProject Life Time25 yearoperating strategyLoad followingSpinning reserve10 % of the load		15000 US\$	
Project Data Project Life Time 25 year operating strategy Load following Spinning reserve 10 % of the load	Efficiency	95 %	
Project Life Time 25 year operating strategy Load following Spinning reserve 10 % of the load	Lifetime	20 year	
operating strategy Load following Spinning reserve 10 % of the load	Project Data		
Spinning reserve 10 % of the load	Project Life Time	25 year	
1 6	operating strategy	U	
Max. Annual Capacity Shortage 1 %	Spinning reserve	10 % of the load	
	Max. Annual Capacity Shortage	1 %	

Several simulations have been made by considering different PV capacities, the number of WG, the number of diesel generator and etc. The COE of hybrid grid-connected WG/Battery system was 0.796 (US\$/kWh) in North as shown in Table IV. The Summary of optimum simulation results for each region are presented in Table IV.

Figs. 19-22 show the monthly average electrical production in the regions in Iran.

## World Academy of Science, Engineering and Technology International Journal of Computer and Systems Engineering Vol:9, No:3, 2015

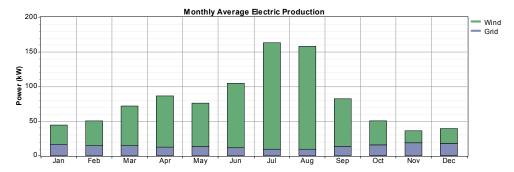


Fig. 19 Monthly average electrical production in North

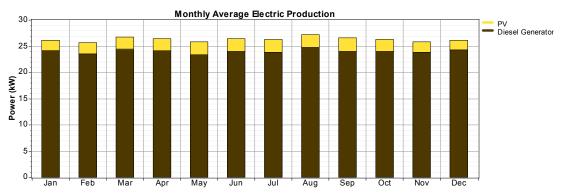


Fig. 20 Monthly average electrical production in South

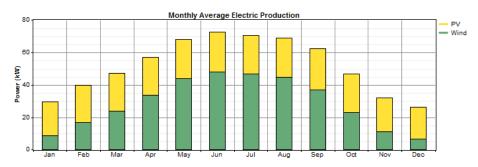


Fig. 21 Monthly average electrical production in East

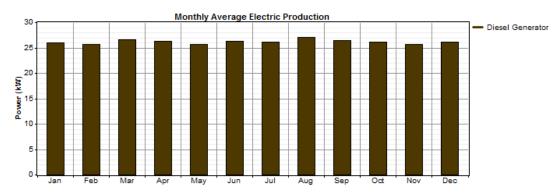


Fig. 22 Monthly average electrical production in West

#### B. Economic Analysis

The aim of this study is to achieve a stand-alone and grid connected hybrid generation system, which should be appropriately designed in terms of economic, reliability, and environmental measures subject to physical and operational

The system cost is defined as sum of PV cost ( $C_{PV}$ ), WG cost  $(C_{WG})$ , battery cost  $(C_{BAT})$ , diesel generator cost  $(C_{DSL})$ , convertor cost ( $C_{CONV}$ ), and electricity cost purchase from the grid ( $C_{Grid}$ ) [20].

$$C_{SYSTEM} = C_{PV} + C_{WG} + C_{BAT} + C_{DSL} + C_{CONV} + C_{Grid}$$
 (1)

The cost for each element should be deducted:

$$C_i = N_i * [CCost_i + RCost_i * K_i + OMCost_i]$$
 (2)  
 $i = PV, WG, Battery, Diesel generator, Converter$ 

where  $N_i$  is the number/size of the system component,  $C_{Costi}$ is the capital cost,  $R_{Costi}$  is the replacement cost,  $K_i$  is the number of replacement, and  $OM_{Costi}$  is operation and maintenance cost through the system operation. Figs. 23-26 show the System component cost in in the regions in Iran.

TABLE IV SUMMARY OF OPTIMUM SIMULATION RESULTS FOR EACH REGION

Region	North	South	East	West
System Components	<b>本本面図</b>	<b>7</b> 🖰 🖅 🛛	┯★雪図	
PV (kW)		10	100	
WG	10		1	
Diesel (kW)		10		40
Battery	1000	10	400	10
Convertor (kW)	300	50	100	10
Grid (kW)	1000			
Total NPC (US\$)	4523921	441177	1720833	377831
COE (US\$/kWh)	0.796	0.078	0.305	0.067
Capacity Shortage	0.00	0.01	0.01	0.01

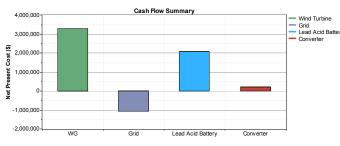


Fig. 23 System component cost in North

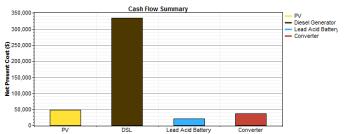


Fig. 24 System component cost in South

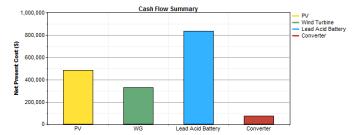


Fig. 25 System component cost in East

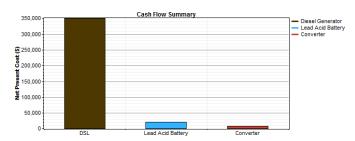


Fig. 26 System component cost in West

#### V. CONCLUSION

Iran is geographically located in a very rich and full of various energy sources. Wind energy potential in the North and East, solar energy potential in the center and south and vast fossil resources in the South are an excellent opportunity for the development of energy sources. Hybrid energy systems with renewable energies if established based on technical and economic studies could obtain substantial economic benefits. In this paper, technical and economic studies and optimum sizing of hybrid energy systems in different regions of Iran were performed using the HOMER software. The results show the good performance of the proposed hybrid energy system proportional to the potential of the regions.

### REFERENCES

- A. Zangeneh, S. Jadid, and A. Rahimi-Kian, "A hierarchical decision making model for the prioritization of distributed generation technologies: A case study for Iran" Energy Policy, Vol. 37, No. 12, pp. 5752-5763, 2009.
- A. Rouhani, S.H. Hosseini, and M. Raoofat, 'Composite generation and transmission expansion planning considering distributed generation' International Journal of Electrical Power & Energy Systems, Vol.62, Jun 2014, pp. 792-805.
- K. Agbossou, M. Kolhe, J. Hamelin, and T.K. Bose, "Performance of a Stand-Alone Renewable Energy System Based on Energy Storage as Hydrogen" IEEE Trans. on Energy Conversion, Vol. 19, No. 3, September 2004.
- F. Bonanno, A. Consoli, A. Raciti, B. Morgana, and U. Nocera, "Transient Analysis of Integrated Diese Wind Photovoltaic Generation Systems" IEEE Trans. on Energy Conversion, Vol. 14, No. 2, June 1999.
- M. Mousavi Badejani, M.A.S. Masoum and M. Kalanta, "Optimal Design and Modeling of Stand-Alone Hybrid PV-Wind Systems" Proc. Int. Conf. on Power Engineering. Australasia, pp. 1-6, Dec. 2007.
- D.B. Nelson, M.H. Nehrir, and C. Wang, "Unit Sizing of Stand-Alone Hybrid Wind/PV/Fuel Cell Power Generation Systems" IEEE Power Engineering Society General Meeting, PP 2116 – 2122, Vol. 3, 2005.
- A. Kashefi Kaviani, G.H. Riahy and SH.M. Kouhsari, "Optimal Design of a Reliable Hydrogen-based Stand-alone Wind/PV Generation System" Proc. Int. Conf. on Optimization of Electrical and Electronic Equipment, PP. 413 - 418, 2008.

276

- [8] M. Hashem Nehrir, "A Course on Alternative Energy Wind/PV/Fuel Cell Power Generation" *IEEE Power Engineering Society General Meeting*, PP 6, 2006.
- [9] T. Zhou, and B. Francois, "Modeling and control design of hydrogen production process for an active hydrogen/wind hybrid power system" ELSEVIER. International journal of hydrogen energy 34 (2009) 21 – 30.
- [10] D. Ipsakisa, S. Voutetakis, P. Seferlis, F. Stergiopoulos, and C. Elmasides, "Power management strategies for a stand-alone power system using renewable energy sources and hydrogen storage" ELSEVIER. International journal of hydrogen energy (2008) 1 – 15.
- [11] B. Zhang, Y. Yang, and L. Gan, "Dynamic Control of Wind/Photovoltaic Hybrid Power Systems Based on an Advanced Particle Swarm Optimization" *Proc. Int. Conf. on Industrial Technology*. PP. 1-6, 2008.
- [12] A. Zahedi, "Technical Analysis of an Electric Power System Consisting of Solar PV Energy, Wind Power, and Hydrogen Fuel Cell" *Universities Power Engineering Conference*. Australasian, PP. 1-5, Dec. 2007.
- [13] National Renewable Energy Laboratory (Online). Available http://www.nrel.gov/international/tools/HOMER/homer.html
- [14] Renewable Energy Organization of Iran (Online). Available: http://www.suna.org.ir/fa/home
- [15] NASA Surface Meteorology and Sola Energy (Online). Available: http://www.nasa.gov
- [16] S. Jalilzadeh, A. Rouhani, H. Kord, and M. Nemati, "Optimum design of a hybrid Photovoltaic/Fuel Cell energy system for stand-alone applications," *IEEE Int. Conf. on Electrical Engineering, and Electronics (ECTI)*, vol. 1, pp. 152-155, Thailand, May 2009.
- [17] A. Jalilvand, H. Kord, and A. Rouhani, "Design, Control and Power Management of a Hybrid PV/WG/FC System for Stand Alone Applications," *Electrical Power Distribution Conference (EPDC)*, Kerman, 2009.
- [18] H. Kord and A. Rouhani, "An Integrated Hybrid Power Supply for Off-Grid Applications Fed by Wind/Photovoltaic/Fuel Cell Energy Systems," Int. Power System Conference (PSC), Tehran, Nov. 2009.
- [19] A. Rouhani, K. Mazlumi, and H. Kord, 'Modeling of a Hybrid Power System for Economic Analysis and Environmental Impact in HOMER' 18th Iranian Conference on Electrical Engineering, Iran, May 2010.
- [20] B. Askari and M. Ameri, "The Effect of Fuel Price on the Economic Analysis of Hybrid (Photovoltaic/Diesel/Battery) Systems in Iran", Energy Sources, Part B: Economics, Planning, and Policy, vol. 6, pp. 357–377, 2011.

Ahmad Rouhani was born in Kazeroon, Iran, in 1984. He received the B.Sc. degree from I.A.U., Bushehr branch, Iran, in 2007, and the M.Sc. degree from Zanjan University, Iran, in 2010, both in Electrical Engineering. Currently, he is a faculty member of I.A.U., Beyza branch, Iran. He is an illustrious talent member of Young Researchers and Elite Club. His research interests include renewable energies, control and stabilization of power systems, application of intelligent methods in power systems, and network expansion planning.